



Fixed Fire Equipment Specifications

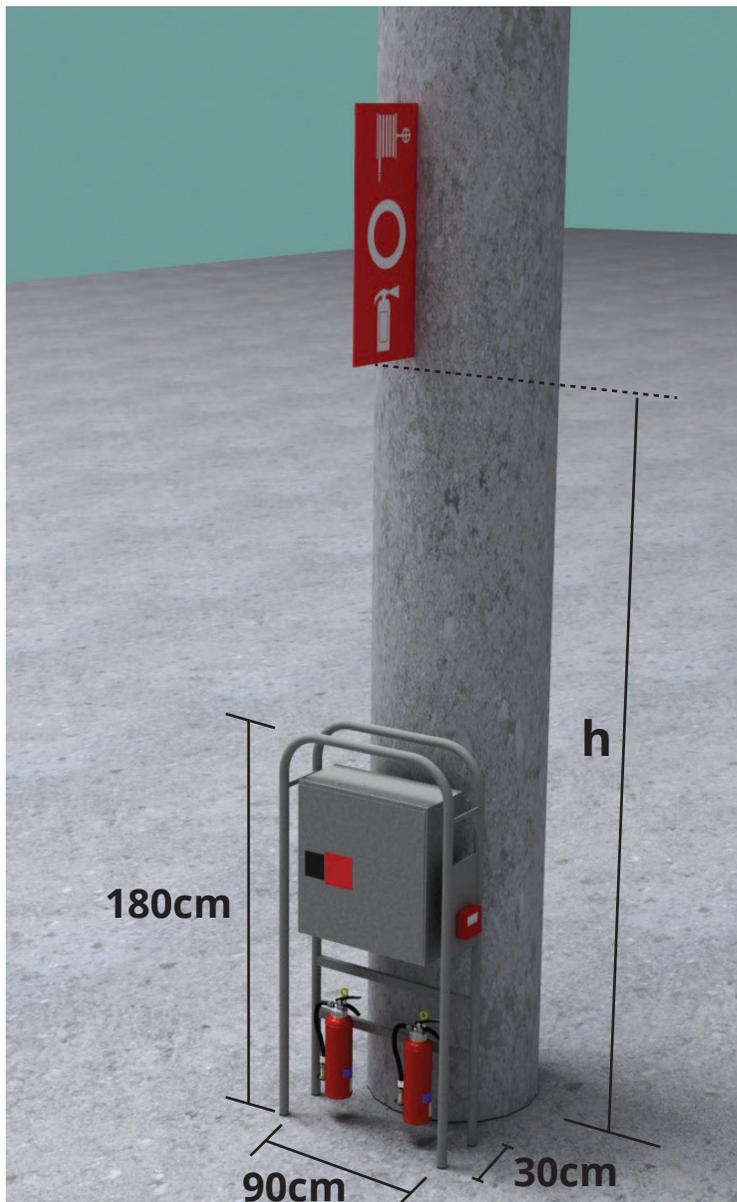


Note that the fire extinguisher equipment can only be cladded if all the equipment remains accessible at all times.

| Hall | h (cm) |
|----------|--------|
| Hall 1 | 295 |
| Hall 2 | * |
| Hall 3 | 490 |
| Hall 4 | 590 |
| Hall 5 | 295 |
| Hall 6 | 545 |
| Hall 7 | 295 |
| Hall 8 | 350 |
| Hall 8.1 | 349 |

* Hall 2 does not have columns in the exhibition area

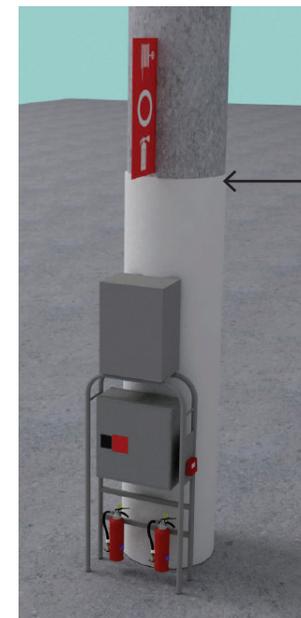

A vinyl can reach up to the upper fire signage

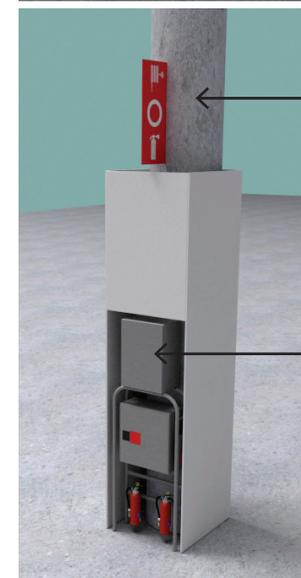

The cladding cannot cover the upper signage

Some of the fire equipment in Halls 3, 4 and 6 include fixed switchboards. Check floor-plans and pictures of the halls in order to see if the specific column includes it or not. The switchboards can be cladded but need to be accessible during build up and dismantling to other exhibitors.